


IF IN DOUBT, ASK!!

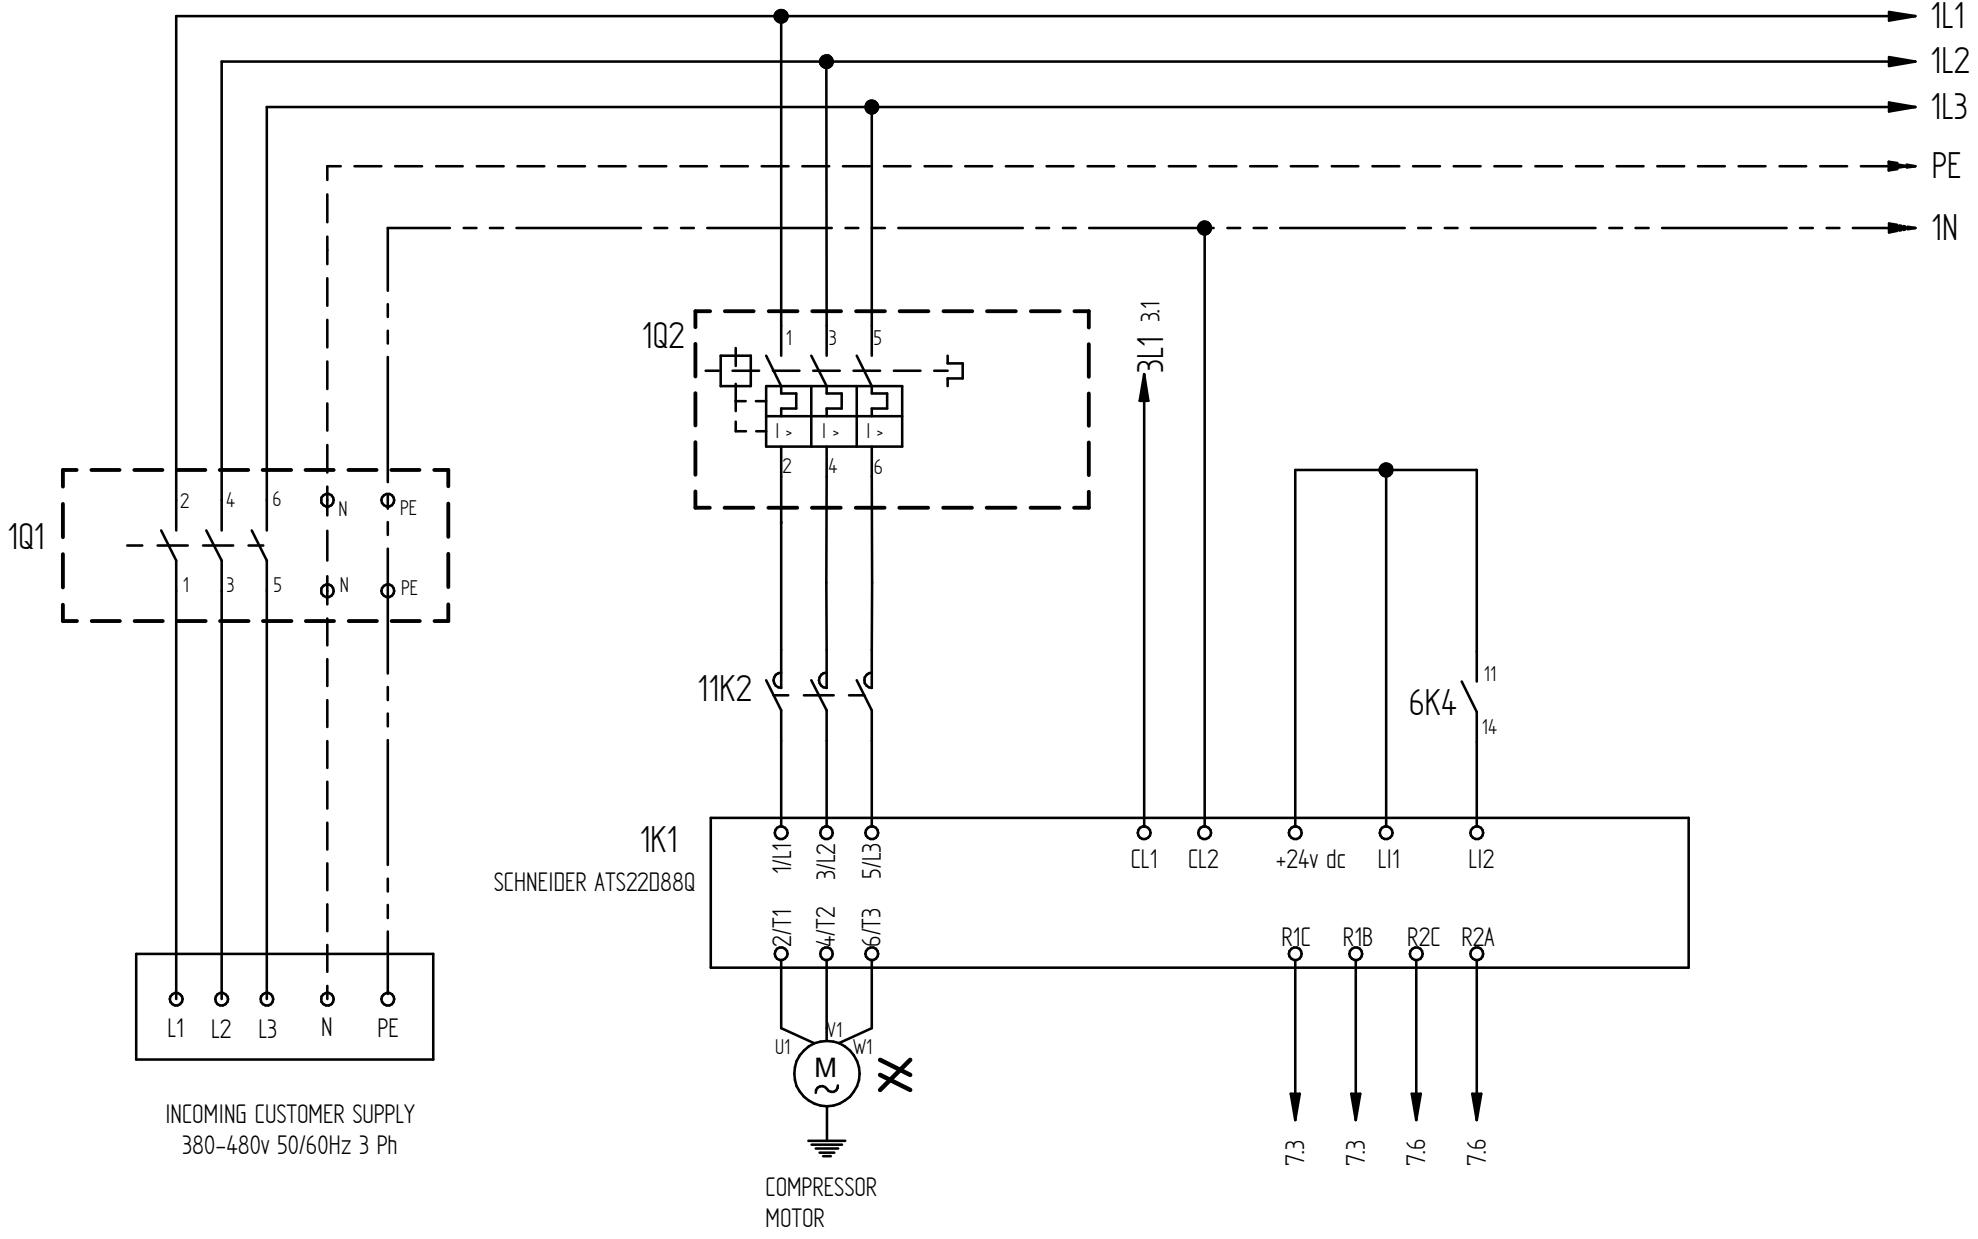


NAME	DATE
DRAWN Jon	15/10/15
CHECKED	

SIZE A4
SHEET 1 OF 7
FILE NAME: S2005.dft

MAXIMATOR® Unit 9 King St Trading Estate
Maximum Pressure. Middlewich, Cheshire, CW10 9LF, UK

ELECTRICAL SCHEMATIC, VP2000 COMPRESSOR
S2005
REV A
DWG NO


IF IN DOUBT, ASK!!

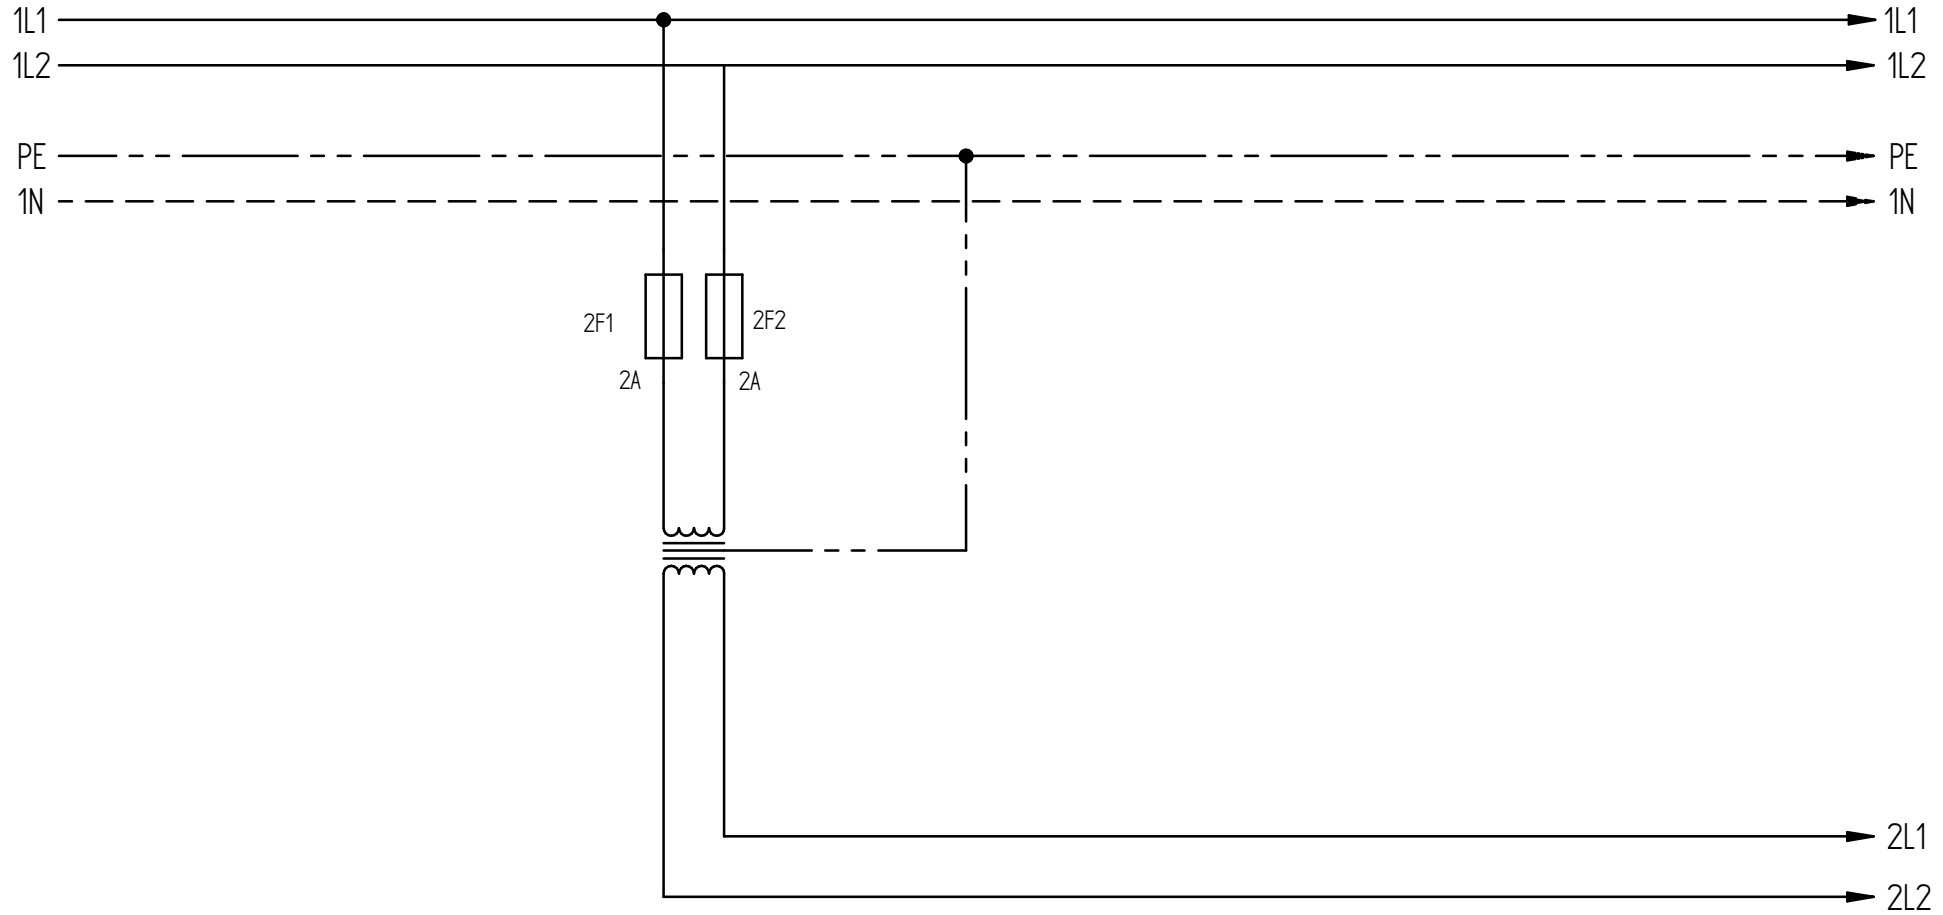

CONTROL
TRANSFORMER
(IF FITTED)

0 1 2 3 4 5 6 7 8 9

IF IN DOUBT, ASK!!

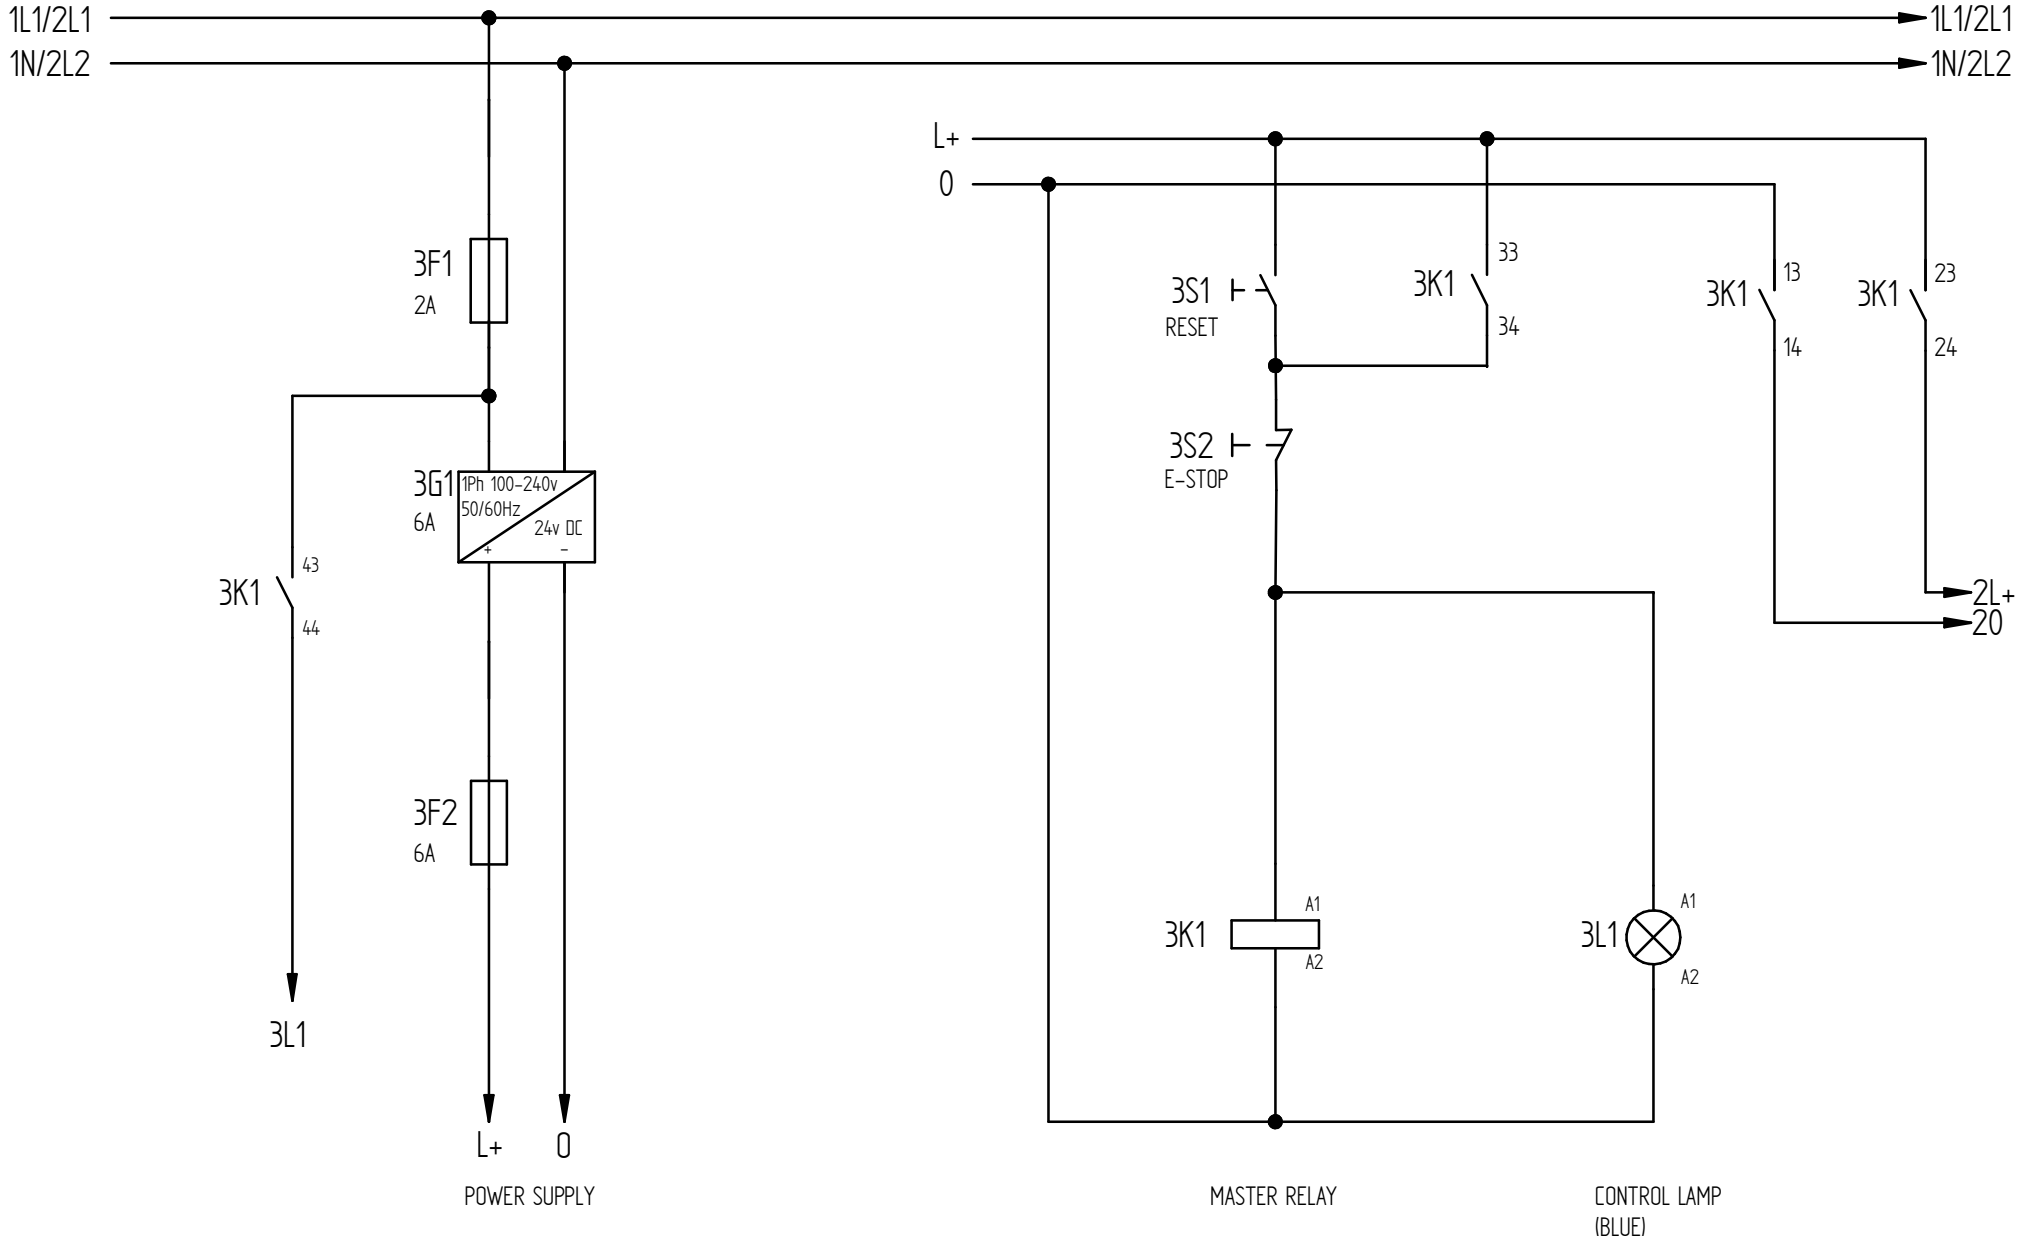

	NAME	DATE
DRAWN	Jon	15/10/15
CHECKED		


SIZE A4
 SHEET 3 OF 7
 FILE NAME: S2005.dft

MAXIMATOR® Unit 9 King St Trading Estate
 Maximum Pressure. Middlewich, Cheshire, CW10 9LF, UK


ELECTRICAL SCHEMATIC, VP2000 COMPRESSOR
 DWG NO S2005
 REV A

IF IN DOUBT, ASK!!


4A1

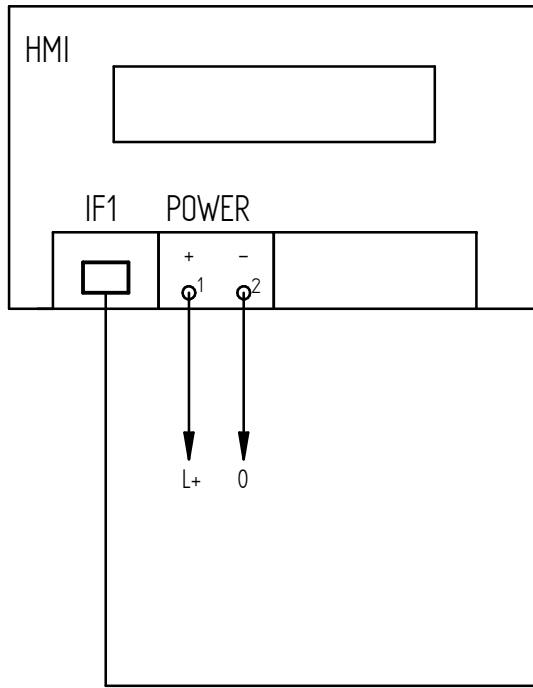

4K1

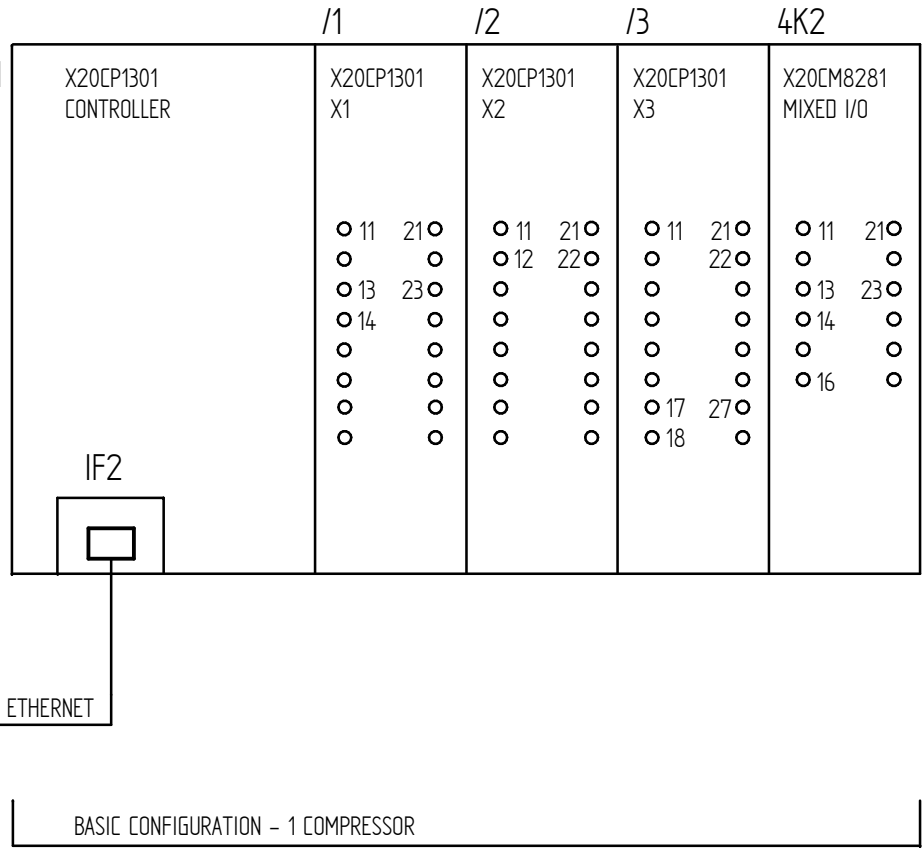

IF IN DOUBT, ASK!!

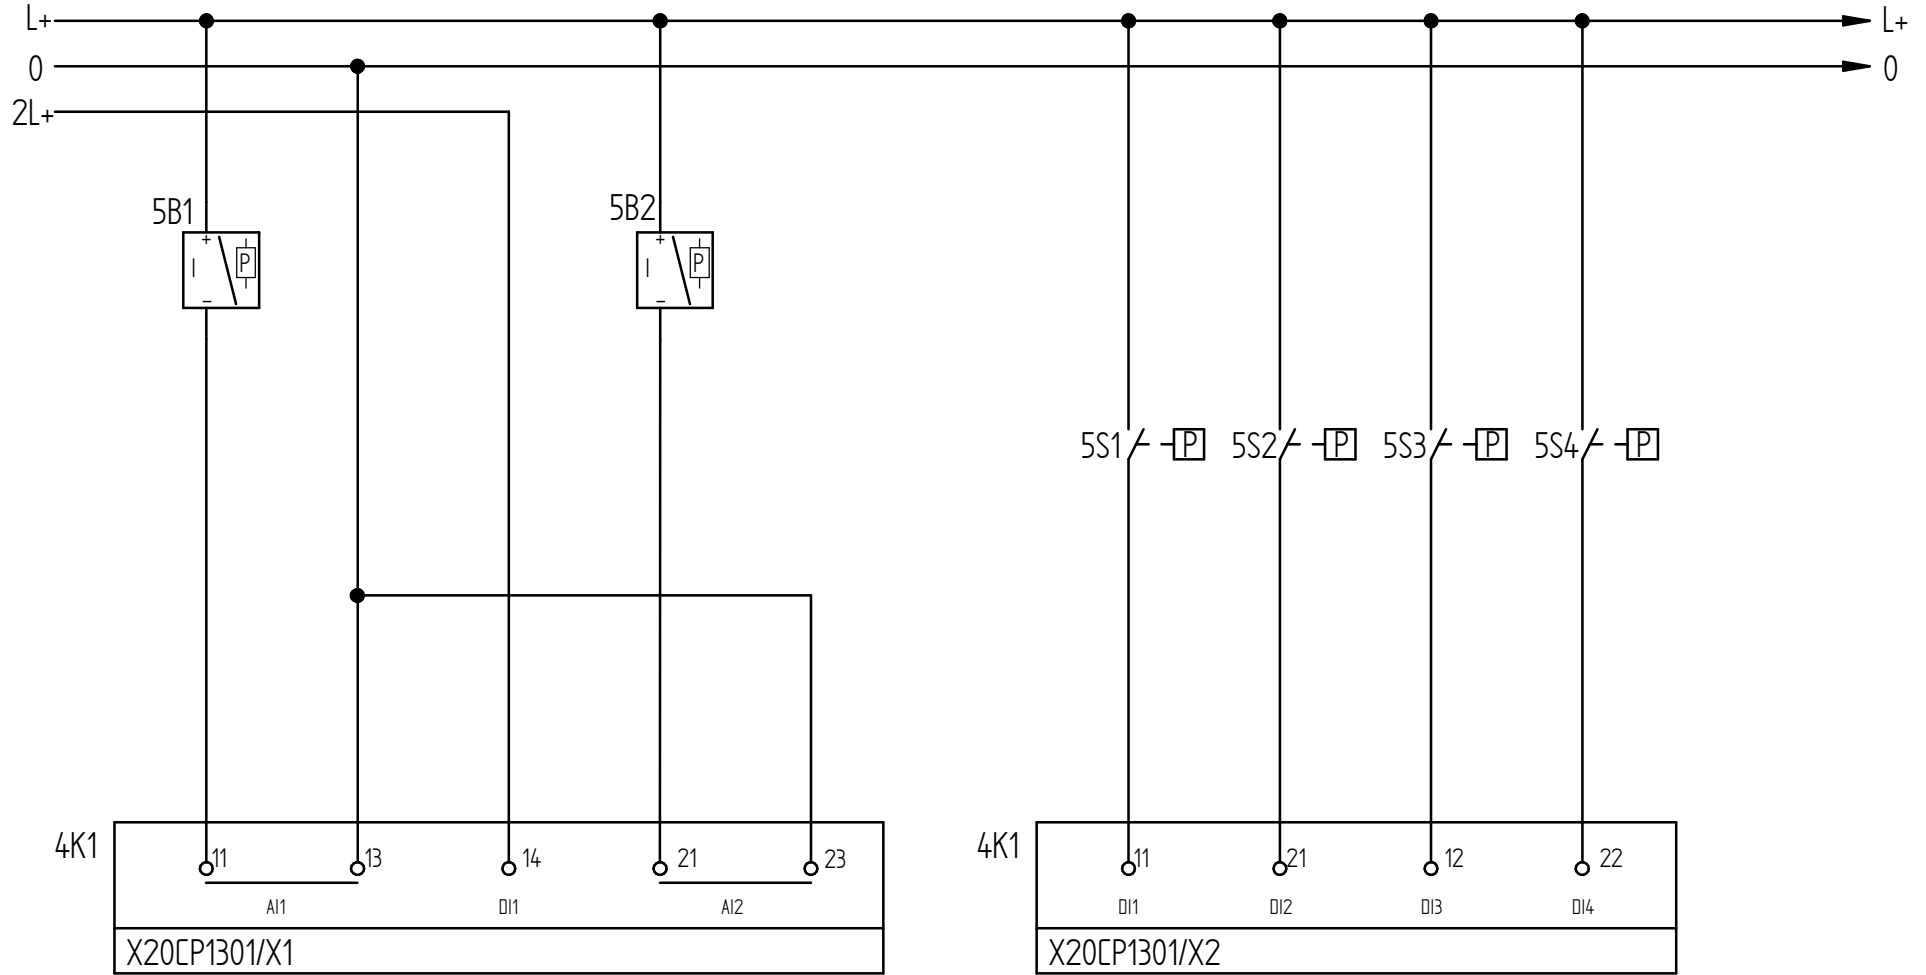

LOW PRESSURE
GAS
4 - 20 mA
0 - 10 BAR

MASTER
RELAY

HIGH PRESSURE
GAS
4 - 20 mA
0 - 400 BAR

COMPRESSOR
STAGE 1
PRESSURE

COMPRESSOR
STAGE 2
PRESSURE

COMPRESSOR
STAGE 3
PRESSURE

COMPRESSOR
STAGE 4
PRESSURE

11 BAR

40 BAR

115 BAR

320 BAR


NAME	DATE
DRAWN Jon	15/10/15
CHECKED	

SIZE A4
SHEET 5 OF 7
FILE NAME: S2005.dft

MAXIMATOR® Unit 9 King St Trading Estate
Maximum Pressure. Middlewich, Cheshire, CW10 9LF, UK

ELECTRICAL SCHEMATIC, VP2000 COMPRESSOR
DWG NO S2005
REV A

IF IN DOUBT, ASK!!

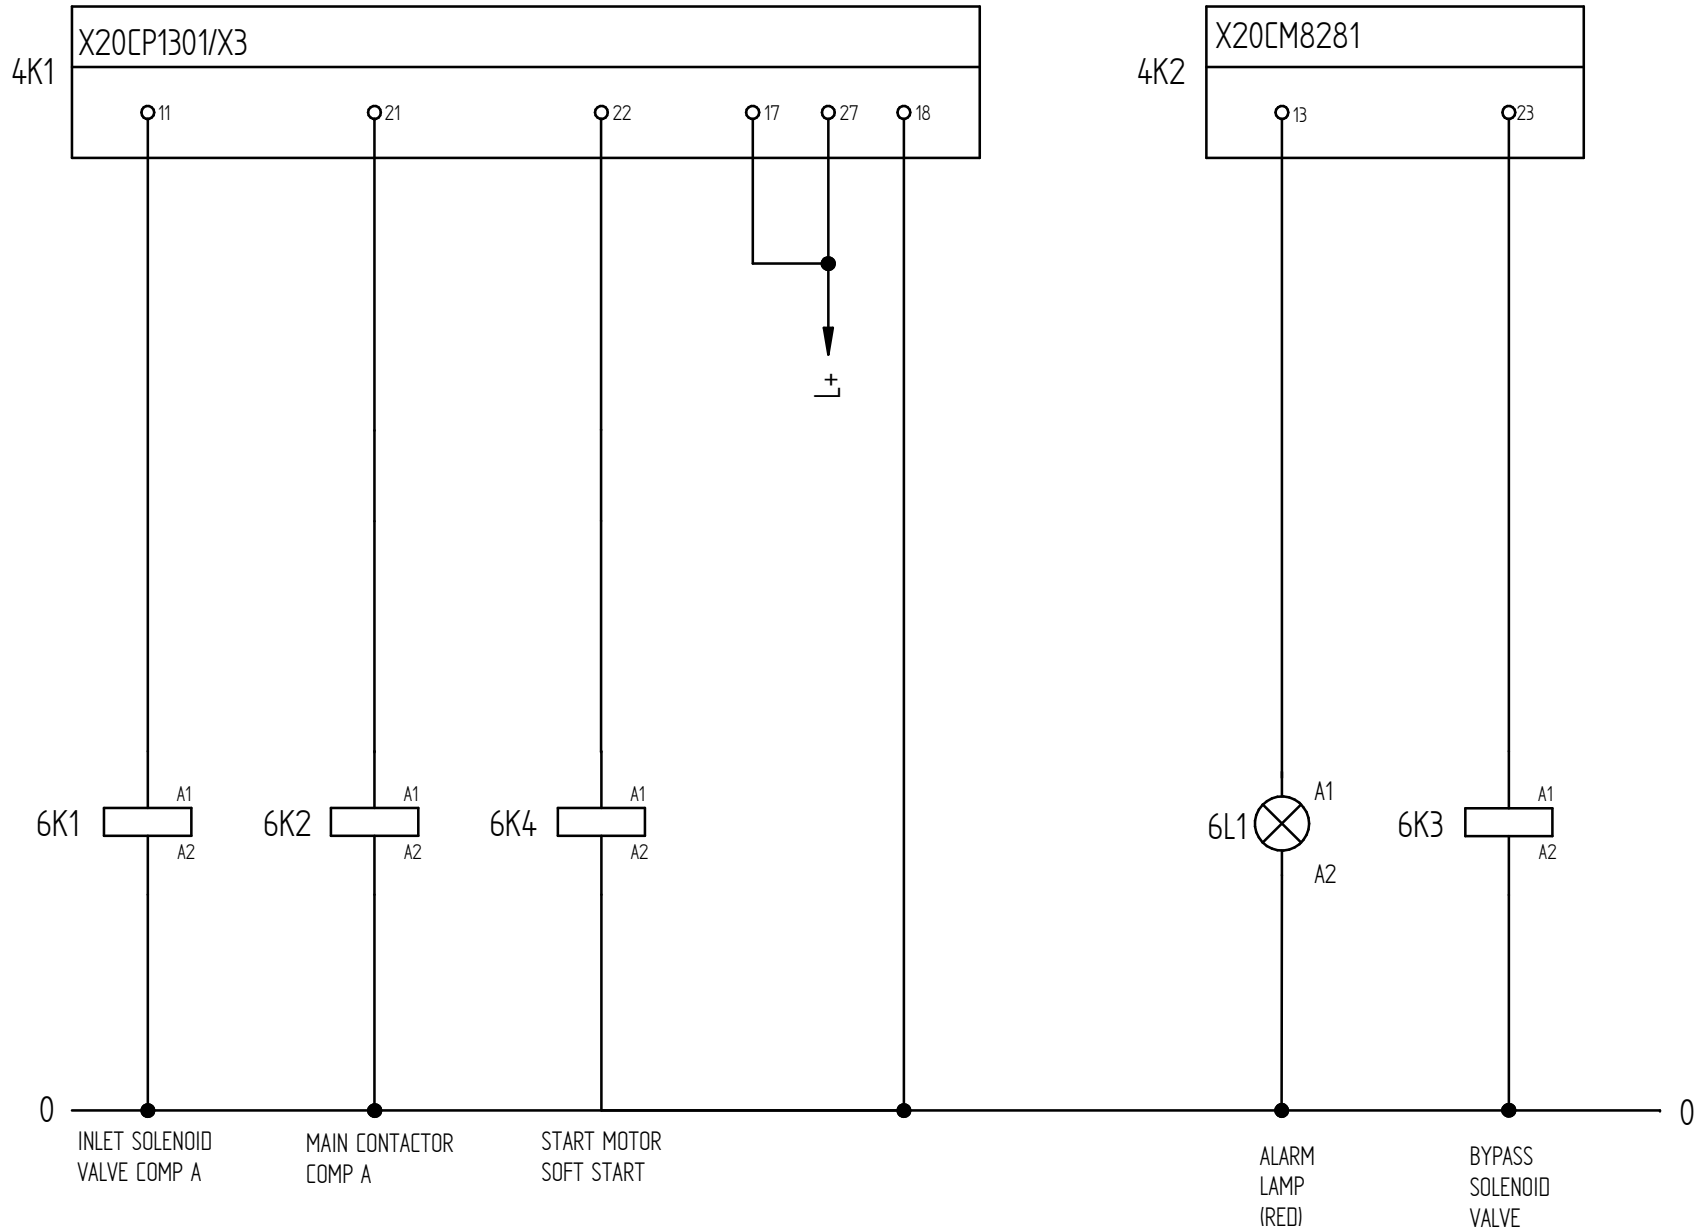

NAME	DATE
DRAWN Jon	15/10/15
CHECKED	


SIZE A4
 SHEET 6 OF 7
 FILE NAME: S2005.dft

MAXIMATOR® Unit 9 King St Trading Estate
 Maximum Pressure. Middlewich, Cheshire, CW10 9LF, UK

ELECTRICAL SCHEMATIC, VP2000 COMPRESSOR
 DWG NO S2005

REV A

IF IN DOUBT, ASK!!

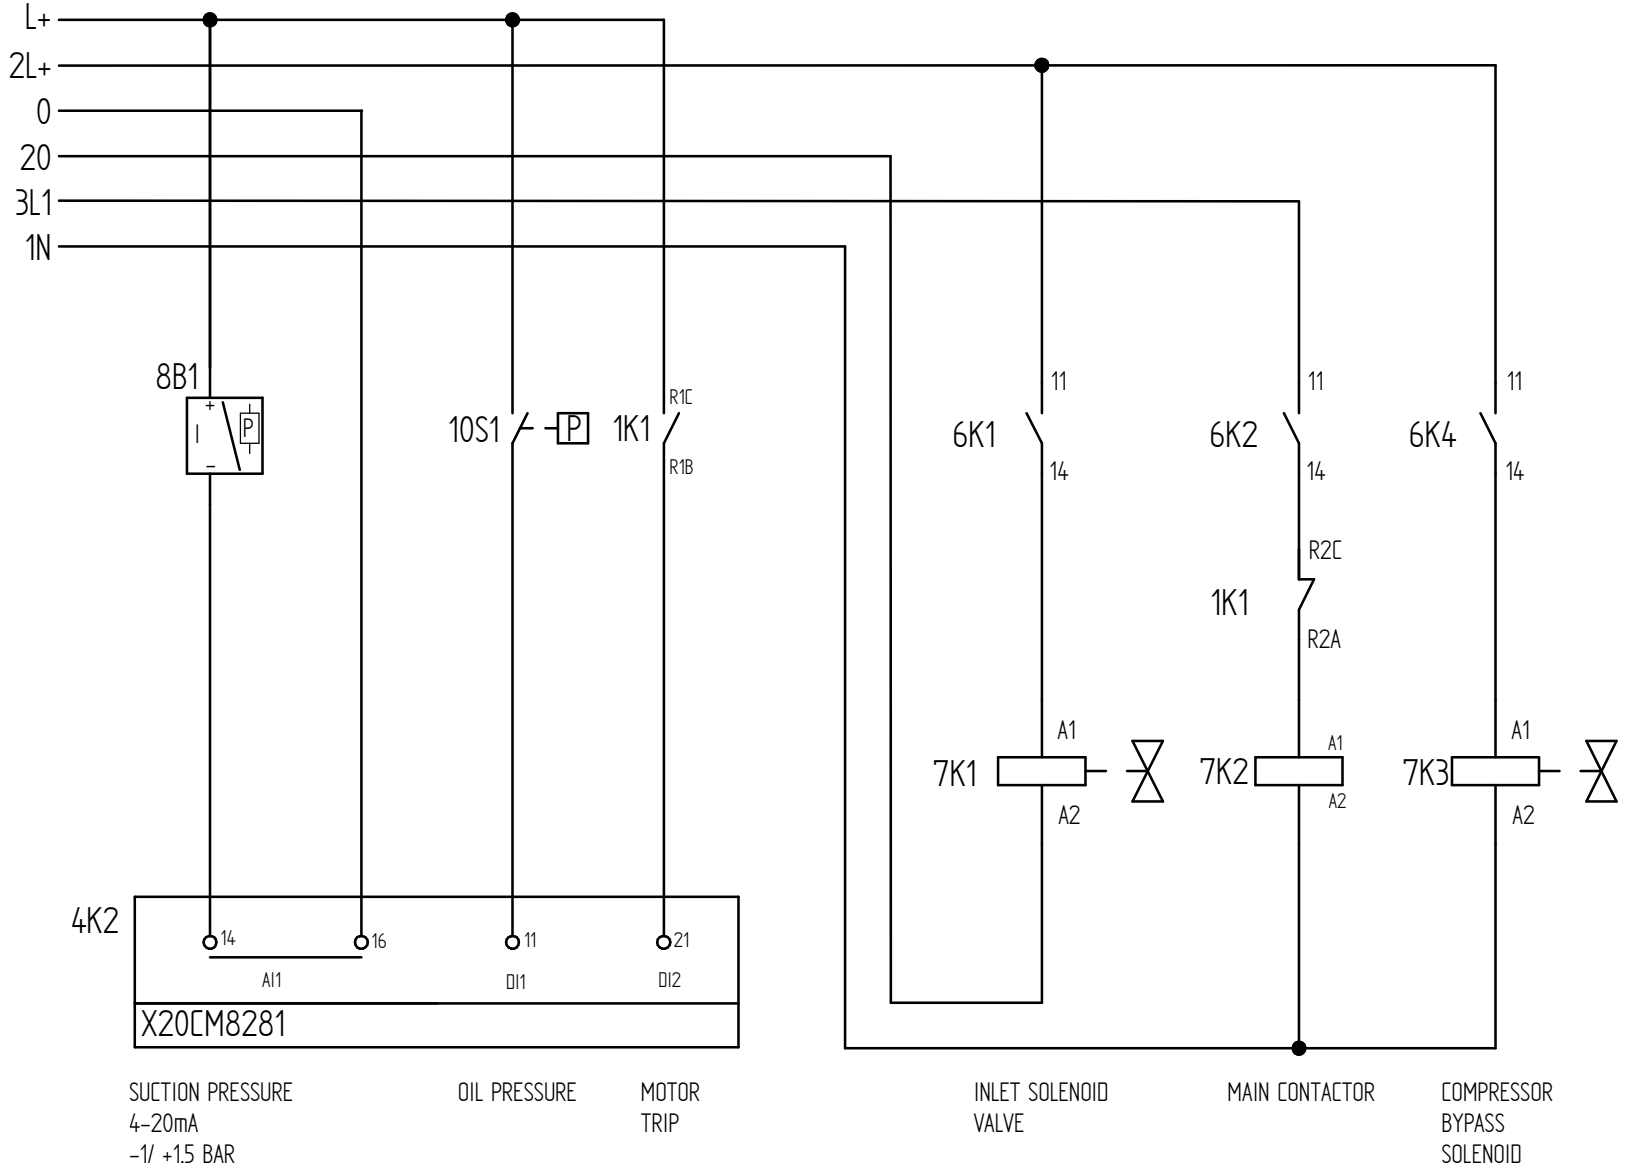

X20CM8281